




www.sfiaust.com.au | 1800 734 000

Eclipse #88WC Sampling Station for Warm Climates



Optional
Casted
Door Logo

Unthreaded
Stainless Steel
Sampling Bibb

1" Flushing
Capability

All Brass
Waterway

1" MIP Inlet



Eclipse #88WC-SS
Stainless Steel Model Also Available



Cast Aluminium
Lockable
Enclosure




Model #88WC-D
Lockable Plastic
Enclosure



Optional
Pedestal



ECLIPSE NO. #88WC-SAMPLING STATION

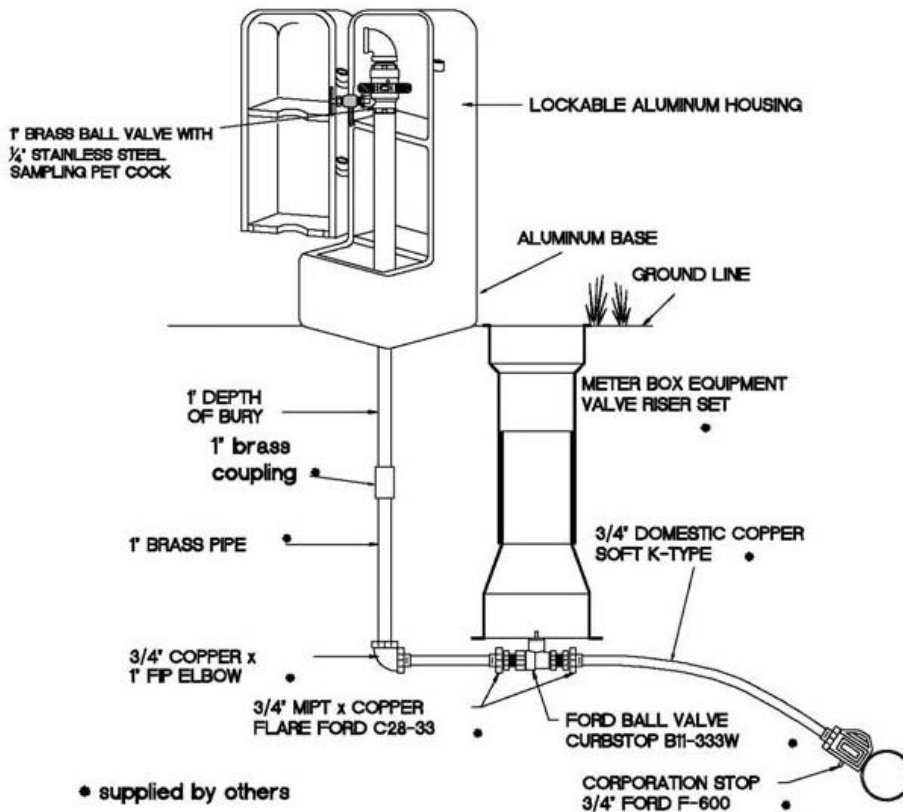

Sampling Stations shall be _____' bury, with a 1" MIP inlet, and a 1" FIP discharge. A 1/4" bent-nose sampling bibb shall be located before the discharge.
All stations shall be enclosed in a lockable, nonremovable, aluminum-cast housing.
When opened, the station shall require no key for operation, and the water will flow in an all brass waterway.
All working parts will be of brass and stainless steel, serviceable from above ground with no digging.
A 1" ball valve will control the water flow, and be located after the sampling bibb, as manufactured by Kupferle Foundry, Model #88WC St. Louis, MO 63102.

DRAWN F.M.	APPROVED	 KUPFERLE FOUNDRY COMPANY 2511 NORTH 6TH STREET, ST. LOUIS, MO 63102 314-231-8738 800-231-3900 FAX 314-231-2820 http://www.hydrants.com
DATE 11-7-12		
THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.		PART NO. #88WC SAMPLING STATION SHEET 1 OF 1



- EPA allowed under the Revised Total Coliform Rule (FEB 2013) for:
- "Reduced potential contamination of sampling taps"
 - "Facilitate access to sampling taps"
 - "To improve sampling representation of the distribution system"

